
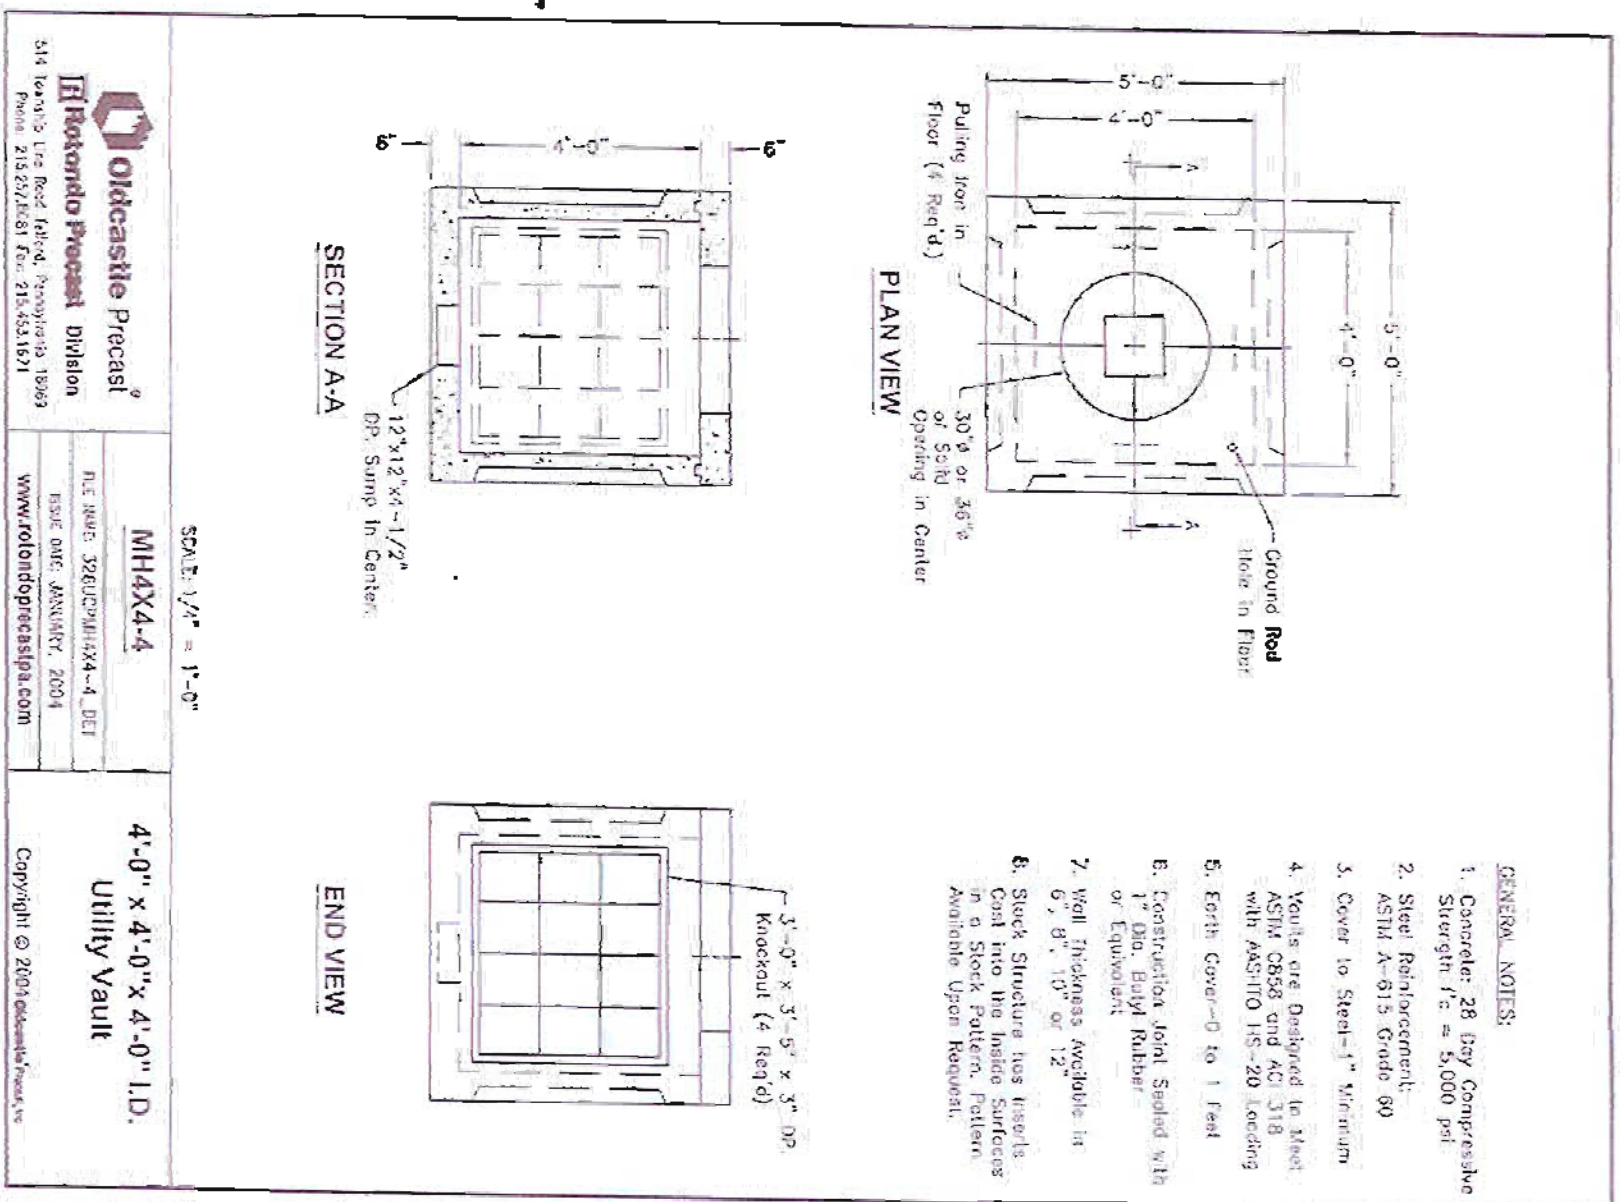


1 ELECTRICAL - SITE PLAN - NEW TELCO WORK


SCALE: 1" = 50'-0"

TELECOMMUNICATION GENERAL NOTES :

1. ALL NEW CONDUITS INDICATED ON THIS DRAWING SHALL BE 4" PVC SCHEDULE 40 DUCT, UNLESS OTHERWISE NOTED.
2. ALL NEW INSTALLED CONDUITS SHALL HAVE A 2" DETECTABLE UNDERGROUND TYPE INSTALLED.
3. ALL EXISTING CONDUITS SHALL BE PROVIDED WITH A BRAC LINE AND TERMINATED WITH BUSHING WHERE APPLICABLE.
4. COORDINATE ALL NEW MAN HOLES AND HAND HOLES LOCATIONS AND CONDUIT ROUTING WITH ACTUAL FIELD CONDITIONS PRIOR TO INSTALLATION.
5. ALL NEW CONDUITS SHALL BE A MINIMUM OF 24" BELOW FINISHED GRADE.

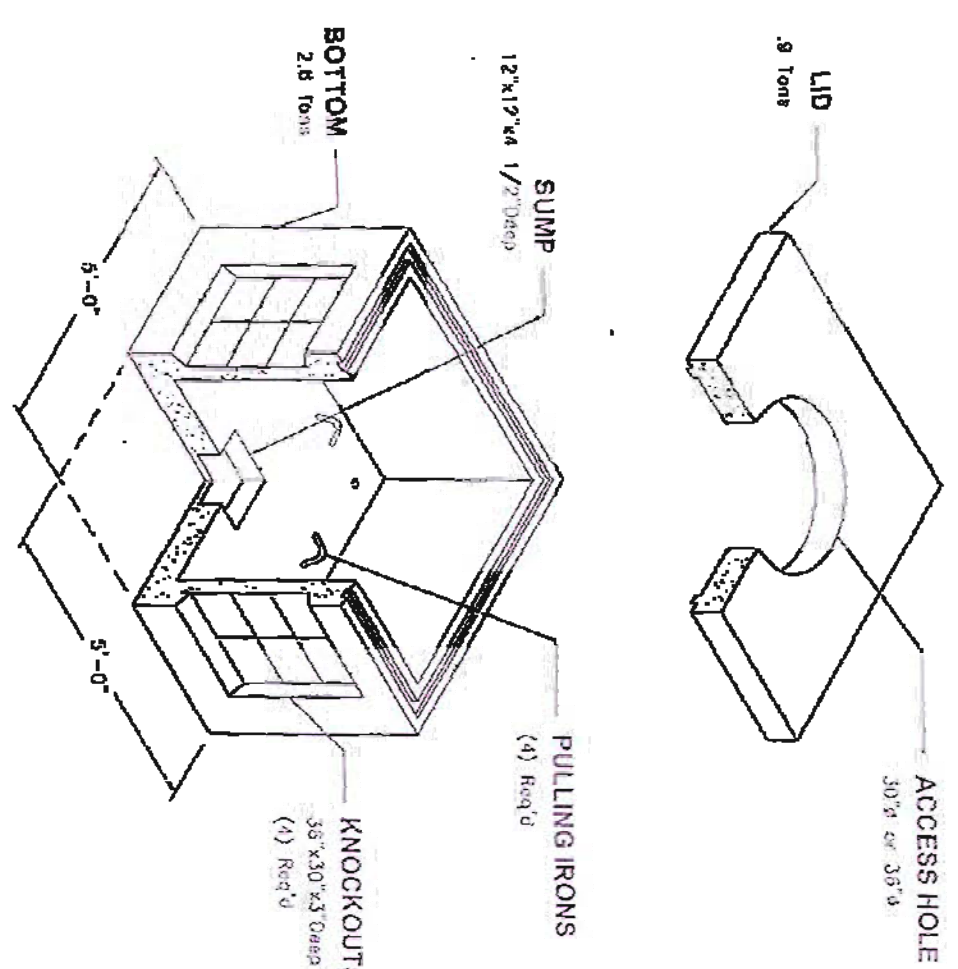

Revisions	Date	Issue	Description
	08-23-2012	A	REVISED PER UTILITY COMPANY STANDARDS
	08-31-2012	B	ISSUED FOR DCA REVIEW
	09-04-2012	C	REVISED PER UTILITY COMPANY REQUIREMENTS

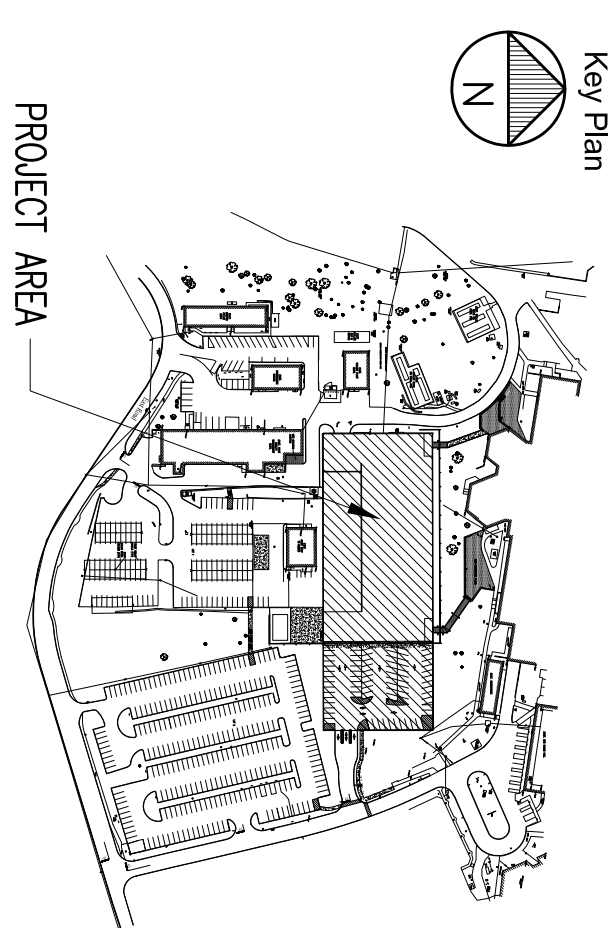

Consultants

Consultants



Consultants

TMG
Engineering
Inc.

Consulting Mechanical
and Electrical Engineer
1090 King Georges Post Rd.
Suite No. 903
Edison, New Jersey 08837
Phone: 732-738-9670
Fax: 732-738-9672

New Jersey Certificate of Authorization
Number 24GA28081900

FRANK S. RADOSIN N.J.P.E. 3392

TWC JOB NUMBER 11-158

New Parking Garage

at


William Paterson University
East Road Parking Lot 1
Wayne, New Jersey 07470
Project # WP-10-03-99A

Site Preparation

Client

William Paterson University
Office of Capital Planning,
Design & Construction

358 Hamburg Turnpike
College Hall
Wayne, New Jersey 07474



SAE Architects & Engineers, PC

1 PARAGON DRIVE . MONTVALE . NEW JERSEY. 0764

TEL: 201.573.1767 FAX: 201.573.0808
WWW.SMS-ARCH-ENG.

)

Fay W. Logan, AIA

John M. Lignos, AIA

Lorin J. Sonenshine, ALA

Steven Napolitano, PE, PP, LEED AP ●

Cert./Lic. No.

Date	Scale	AS NOTED
------	-------	----------

Drawn By	Ken S.	Checked By	P.B.
----------	--------	------------	------

UWG. 11116
ELECTRICAL - SITE PLAN - NEW

TELCO WORK

Work Order No.	Dwg. No
----------------	---------