

LEGEND



Security Camera (By WPU)




Wireless Access Point Device (by WPU)



Door Electronic Lock (By WPU)



One Data Box with (2) Data Jacks

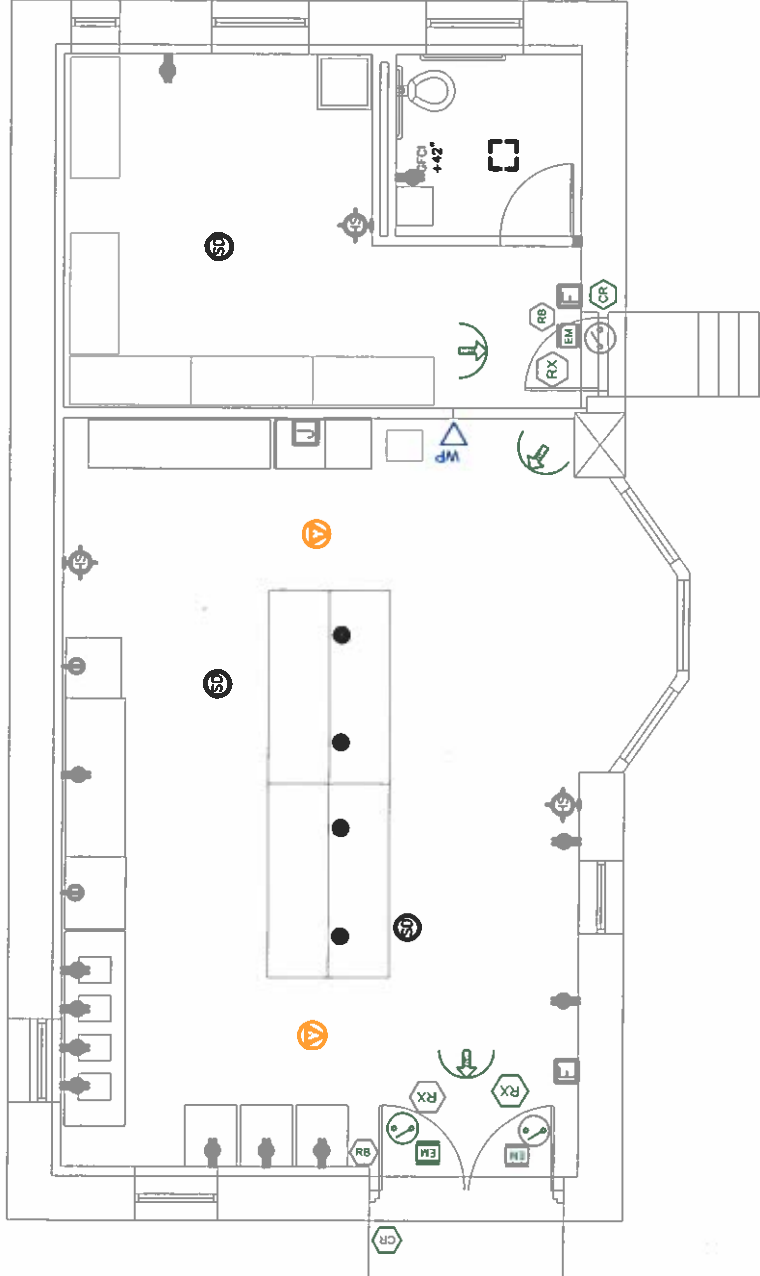

FIRST FLOOR POWER PLAN


SCALE: 1/4" = 1'-0"

Connect all devices with CAT 6A Cable and terminate in 2nd Floor Data Closet.

BMS, Access Control and Fire Alarm devices Terminate in new Simplex Panel in 2nd Floor Mechanical Room.

NEW FIRE ALARM PANEL PROVIDE CONNECTION TO RAUBINGER HALL FIRE ALARM SYSTEM WITH 1-1/2" CONDUIT UNDER DRIVEWAY ALSO PROVIDE ADDITIONAL SPARE 1-1/2" CONDUIT TO RAUBINGER HALL

(3) 1/0 CU WITH #6 CU IN 2" PVC CONDUIT UNDERGROUND TO MAIN SWITCHGEAR IN RAUBINGER HALL PROVIDE NEW 200A-2P FUSE IN EXISTING SPARE BUCKET IN SWITCHGEAR REFER TO SITE PLAN FOR ROUTING.



SECOND FLOOR POWER PLAN

SCALE: 1/4" = 1'-0"

Carriage House Clarification Drawing CL-1

August 20, 2021